TMD EXTERNAL CONTROL WIRING OPTION 1

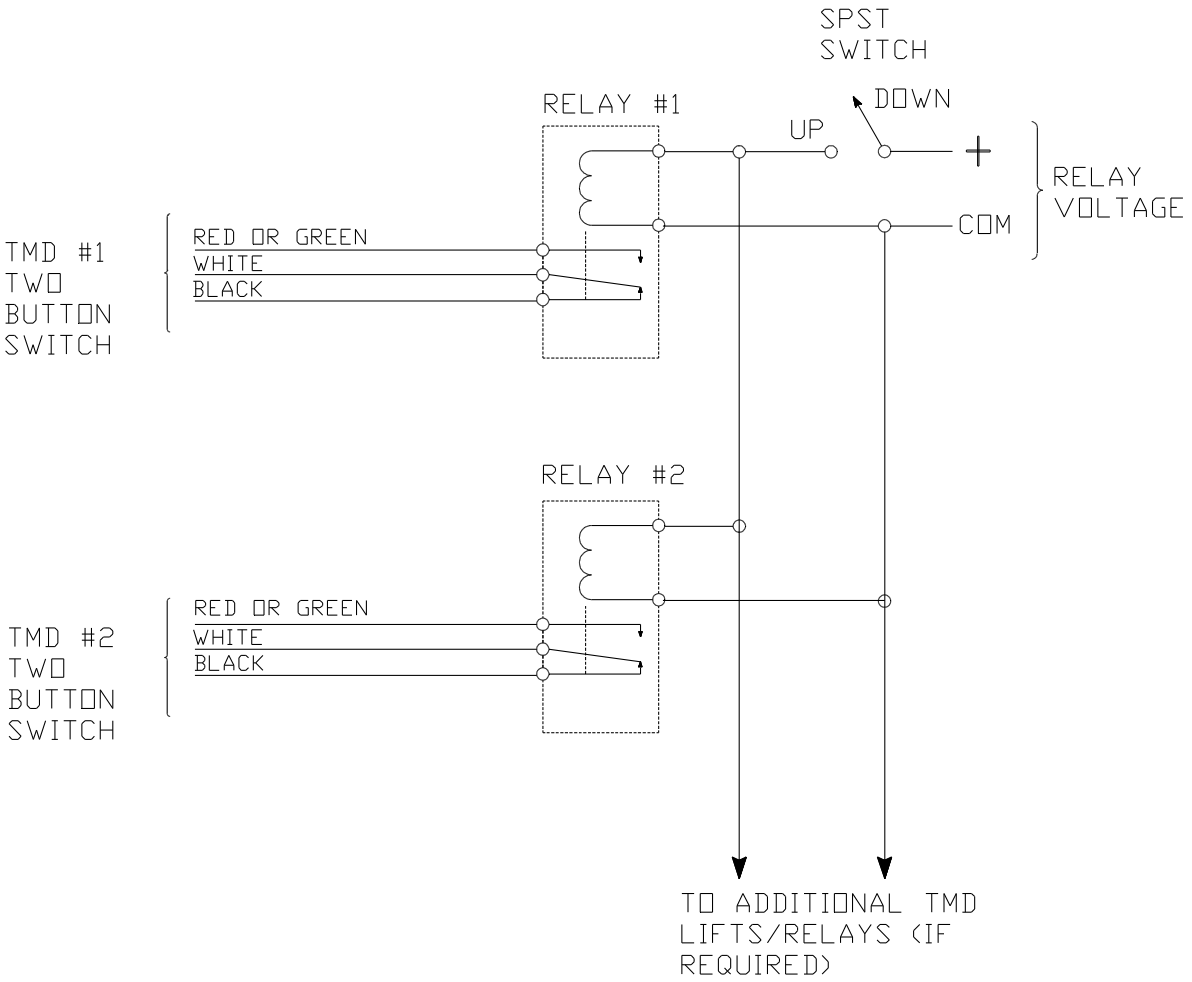

NOTES:

1. THIS OPTION DISABLES THE TWO BUTTON SWITCH.

2. THE UP AND DOWN RELAYS MUST BE WITHIN THREE FEET OF TWO BUTTON SWITCH.

3. FOR ONE TMD LIFT USE RELAY #1 AND ASSOCIATED WIRING.

4. FOR ADDITIONAL TMD LIFTS ADD RELAY #2 AND ASSOCIATED WIRING FOR EACH ADDITIONAL LIFT.

5. RELAYS, SWTICHES, AND WIRING ARE CUSTOMER SUPPLIED.

© COPYRIGHT		SCALE APPROX	SVS INC.
DRAWN BY:	D.B.		SVS TMD EXTERNAL CONTROL OPTION 1
CHECKED BY:	C.H.		DRAWING NO. TMD EXTERNAL MOD OPT1.DWG
DESIGNED BY:	SVS		
CAGE CODE:	OKPR7	2-89	SERIAL NO. / RELEASE DATE 01/20/06
PHONE:	850-522-4747		